



NOTE:  
IF "D" ≤ 15 FT. NO  
PULL BOX, IF "D" >  
15 FT. PULL BOX IS  
REQUIRED AT BASE  
OF LIGHT POLE.

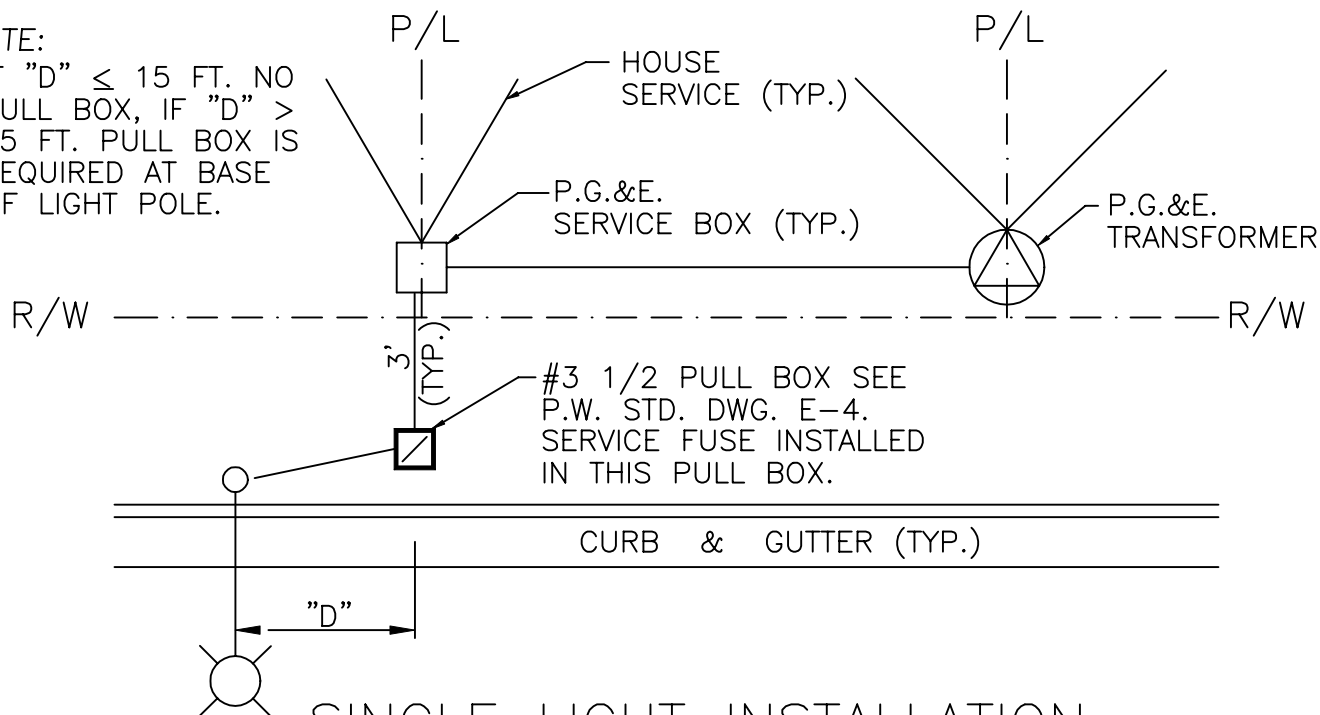

## SINGLE LIGHT INSTALLATION

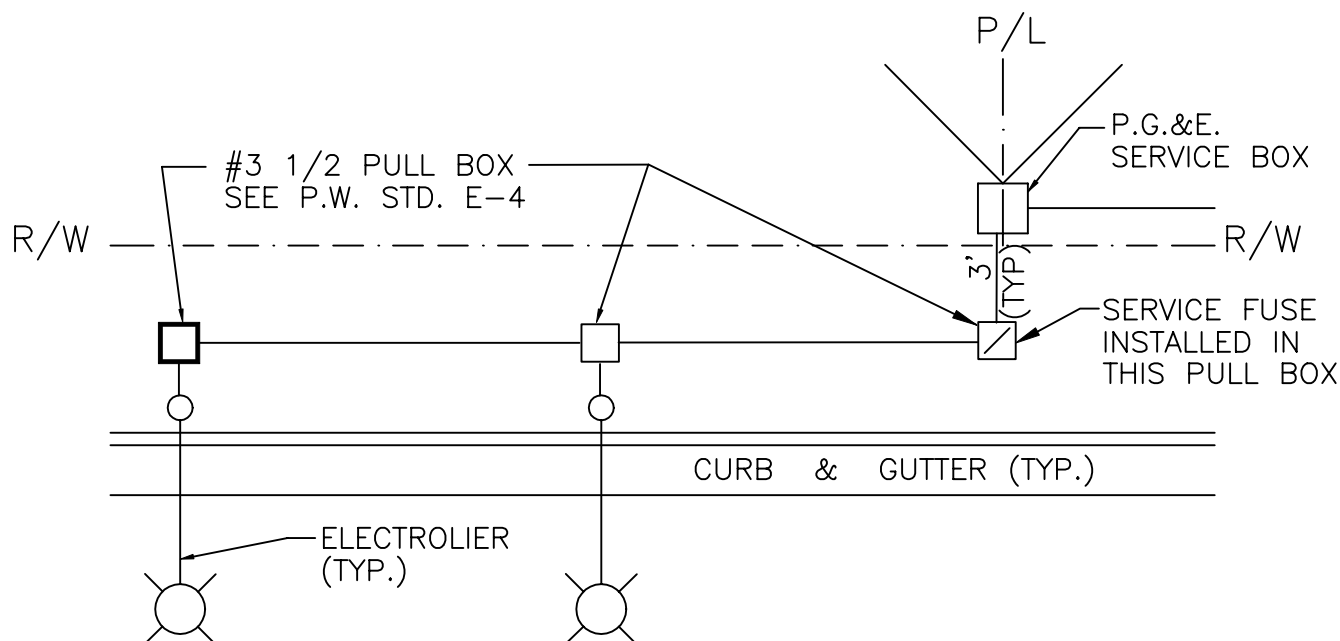

## MULTIPLE LIGHT INSTALLATION

1. CONDUIT SHALL BE SCHEDULE 40 PVC ON LOCAL STREETS AND SCHEDULE 80 PVC ON MAJOR STREETS. LOCAL STREET CROSSINGS SHALL BE SCHEDULE 80 PVC, AND MAJOR STREETS CROSSINGS SHALL BE GALVANIZED RIGID CONDUIT.
2. LOCATE STREET LIGHTS ON THE SAME SIDE OF THE STREET AS THE P.G.&E. SERVICE WHEN POSSIBLE.
3. DO NOT LOCATE THE PULL BOXES ABOVE THE JOINT TRENCH.
4. PULL BOX SPACING SHALL NOT EXCEED 200' AND SHALL BE REQUIRED IN ALL CONDUIT CHANGE OF DIRECTION.